

The data should be read in conjunction with the Power Triode Preamble.

ABRIDGED DATA

The BW1185J2B is a water cooled power triode of coaxial ceramic/metal construction, intended primarily for industrial service. It has a bolt-on water jacket.

Anode dissipation	120	kW max
Anode voltage	16.8	kV max
Frequency for full ratings	30	MHz max
Output power (class C oscillator, less drive)	240	kW

GENERAL

Electrical

Filament	thoriated tungsten
Filament voltage (see note 1)	12.6 V
Filament current	380 A
Surge filament current (peak (see note 2)	2000 A max
Filament cold resistance	3.6 mΩ
Peak usable cathode current	175 A
Amplification factor ($V_a = 14$ kV, $I_a = 10$ A)	40
Mutual conductance ($V_a = 14$ kV, $I_a = 10$ A)	190 mA/V
Inter-electrode capacitances:	
grid to anode	60 pF
grid to filament	185 pF
anode to filament	3.0 pF

Mechanical

Overall length	446.0 mm max
Overall diameter	190.5 mm max
Net weight	15.6 kg approx
Mounting position (see note 3)	vertical, anode up or down

Accessories

Water coupling, 2 supplied with BW1185J2B	MA709B
Water union, 25 mm hose (optional)	MA2654A
Filament connector (with lead)†	MA475A
Filament connector (without lead)†	MA291C
Filament/cathode connector (with lead)†	MA475B
Filament/cathode connector (without lead)†	MA291D

For frequencies above 2 MHz, cathode connector MA291F should be used in conjunction with a strip connection to provide a low inductance cathode return.

Grid connector:	
above 2 MHz	MA342
below 2 MHz	MA464
Thermal fuse	MA85G

† The tightening torque applied to the clamping screw must be between 0.231 kg.m min and 0.404 kg.m max.



RADIO FREQUENCY OSCILLATOR FOR INDUSTRIAL SERVICE

(Class C conditions, one tube)

MAXIMUM RATINGS (Absolute values)

Frequency	30	MHz
Anode voltage	16.8	kV max
Anode input power	375	kW max
Anode dissipation	120	kW max
Grid voltage (negative value)	2.0	kV max
Grid current:		
on load	7.0	A max
off load	8.5	A max
Grid dissipation	3.0	kW max
Grid circuit resistance	10	kΩ max
Cathode current	31	A max

COOLING

Anode

The BW1185J2B has an integral water jacket. The water cooling requirements are given in the following table.

Anode plus grid dissipation (kW)	Inlet temperature (°C)	Minimum rate of flow of water l./min	Inlet pressure (kPa)	Outlet temperature (°C)
120	20	60	70.9	50
120	50	90	131.7	70
80	20	34	30.4	55
80	50	54	55.7	72
40	20	15	7.1	62
40	50	24	13.2	76

The inlet water temperature must never exceed 50 °C. The water pressure must never exceed 600 kPa.

Seals and Envelope

The temperature of the seals and envelope must not exceed 200 °C. Cooling of the seals by low velocity air flow or water cooled filament connectors is required.

TYPICAL OPERATING CONDITIONS

Frequency	30	30	30	MHz
Anode voltage	10	12	14	kV
Anode current	23.6	24.7	23.5	A
Anode dissipation	56.6	67.4	81.5	kW
Grid voltage	−580	−695	−810	V
Grid resistor	87	108	135	Ω
Grid current, on load	6.7	6.4	6.0	A
Grid current, off load	8.4	8.0	8.0	A
Grid dissipation	2.6	2.6	2.6	kW
Feedback ratio (see note 4)	9.1	10.5	11	%
Drive power	6.4	7.1	7.5	kW
Output power	179.4	229.3	247.5	kW
Efficiency	76.0	77.3	75.2	%
Oscillator output power (see note 5)	173.0	222.2	240	kW

NOTES

- Temporary fluctuations up to +5% or −10% in filament voltage are permissible.
- The filament current must not exceed 2000 A, even momentarily, at any time.
- If the tube is mounted with the anode uppermost, the water inlet and outlet connections should be reversed (see outline).
- The feedback ratio is defined as $\frac{V_{g(pk)}}{V_{a(pk)}} \times 100$
 where $V_{g(pk)}$ = peak RF grid voltage in volts
 and $V_{a(pk)}$ = peak RF anode voltage in volts
- Oscillator output power = $P_{out} - P_{drive}$
 where P_{out} = output power of tube to anode circuit
 and P_{drive} = drive power fed back to grid circuit.

HEALTH AND SAFETY HAZARDS

e2v technologies electronic devices are safe to handle and operate, provided that the precautions stated are observed. e2v technologies does not accept responsibility for damage or injury resulting from the use of electronic devices it produces. Equipment manufacturers and users must ensure that adequate precautions are taken. Appropriate warning labels and notices must be provided on equipments incorporating e2v technologies devices and in operating manuals.



High Voltage

Equipment must be designed so that personnel cannot come into contact with high voltage circuits. All high voltage circuits and terminals must be enclosed and fail-safe interlock switches must be fitted to disconnect the primary power supply and discharge all high voltage capacitors and other stored energy before allowing access. Interlock switches must not be bypassed to allow operation with access doors open.



RF Radiation

Personnel must not be exposed to excessive RF radiation. A properly designed equipment cabinet with good RF electrical connection between panels will normally provide sufficient protection.



X-Ray Radiation

This device, when operating at voltages above 5 kV, produces progressively more dangerous X-rays as the voltage is increased; the radiation varies greatly during life. The device envelope provides only limited protection and further shielding may be required. A metal equipment cabinet with overlapping joints will usually provide sufficient shielding, but if there is any doubt an expert in this field should perform an X-ray survey of the equipment.




Implosion

This tube stores potential energy by virtue of its vacuum. The energy level is low, but there is some hazard from flying fragments if the tube is dropped or subjected to violent impact. The tube must be stored and transported in its approved pack. During installation or replacement the tube must not be scratched or damaged in any way likely to reduce the strength of the ceramic envelope.


References

- BS 3192. Specification for safety requirements for radio (including television) transmitting apparatus.
- TEPAC Publication no. 181. Recommended practice on X-radiation detection and measurement for high power tubes.

TYPICAL CONSTANT CURRENT CHARACTERISTICS

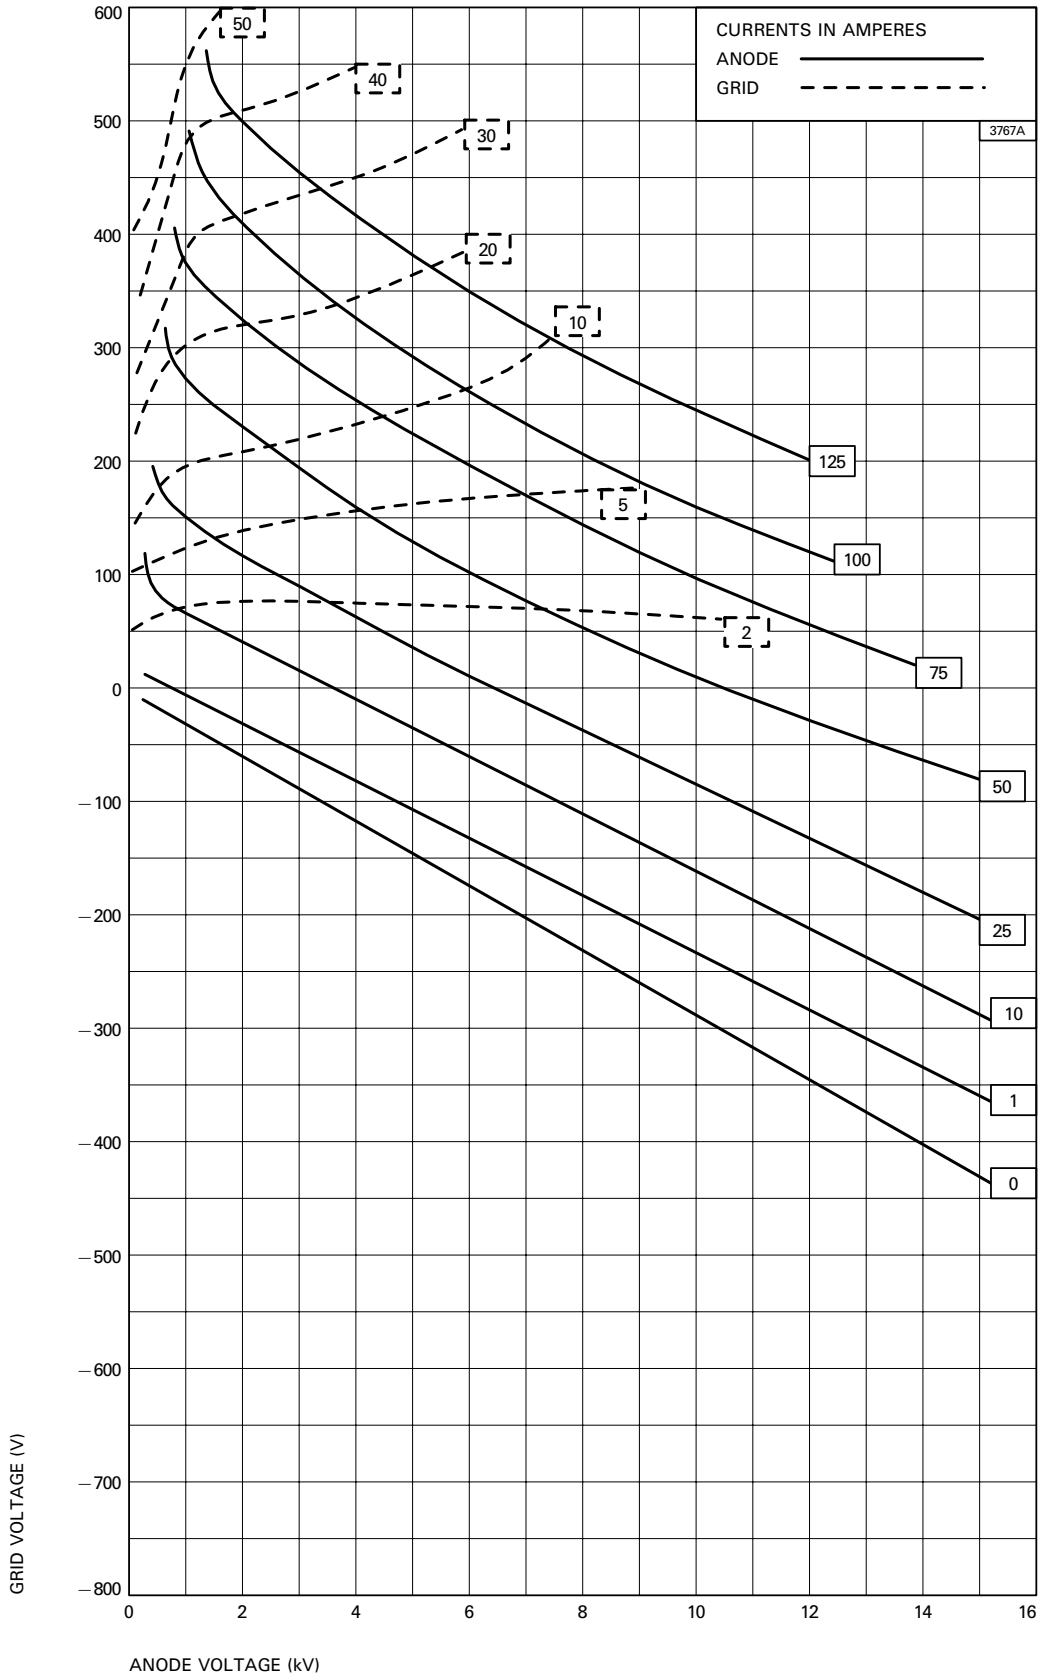

OUTLINE (All dimensions without limits are nominal)

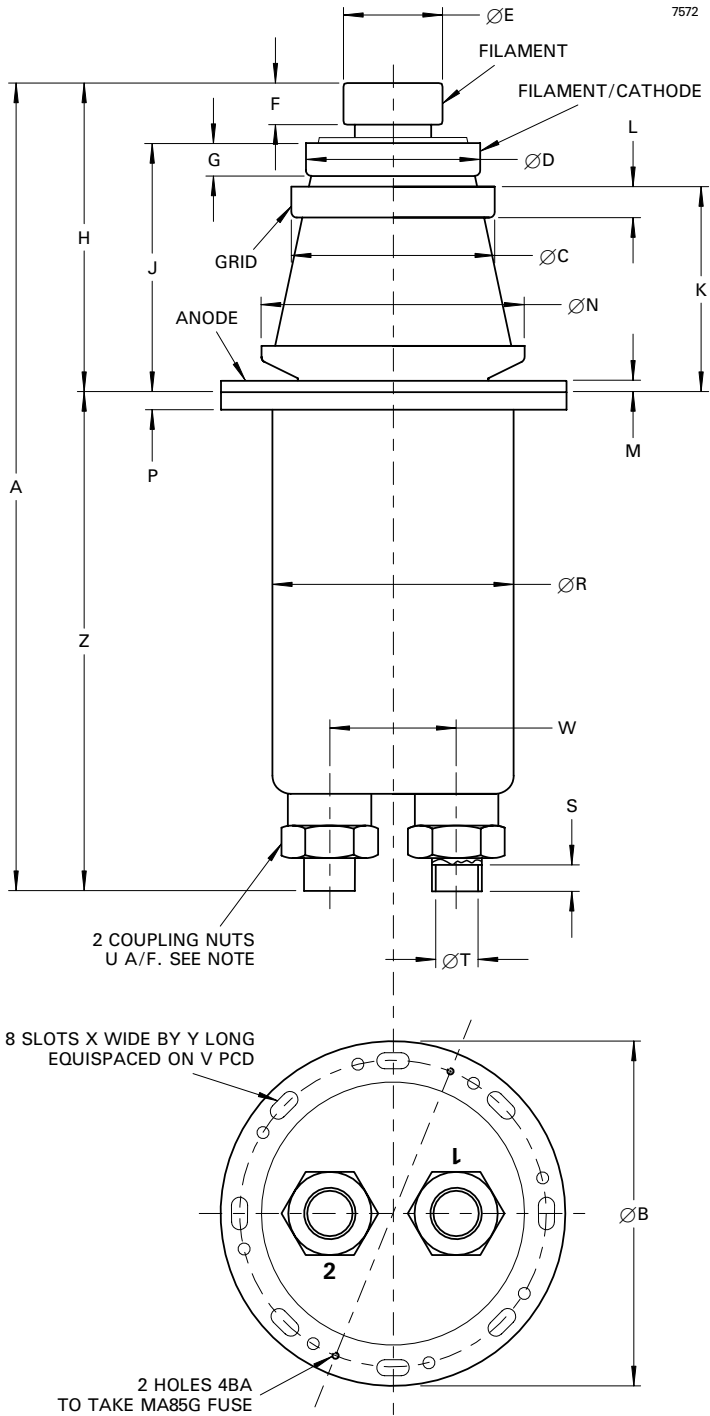

Ref	Millimetres
A	446.0 max
B	190.5 max
C	112.0 ± 0.2
D	96.0 ± 0.2
E	54.0 ± 0.15
F	23.0
G	15.0
H	171.5 max
J	137.0
K	113.0
L	14.0
M	6.3
N	145.0 max
P	9.5
R	143.0 ± 1.0
S	18.5
T	28.0
U	46.0
V	170.0
W	70.0
X	9.0
Y	18.0
Z	270.0

Outline Note

Suitable water pipe connectors are supplied with BW1185J2B.

Water Connections

	Anode down	Anode up
Inlet	1	2
Outlet	2	1

Whilst e2v technologies has taken care to ensure the accuracy of the information contained herein it accepts no responsibility for the consequences of any use thereof and also reserves the right to change the specification of goods without notice. e2v technologies accepts no liability beyond that set out in its standard conditions of sale in respect of infringement of third party patents arising from the use of tubes or other devices in accordance with information contained herein.